


Typical Overhead Electrical Service

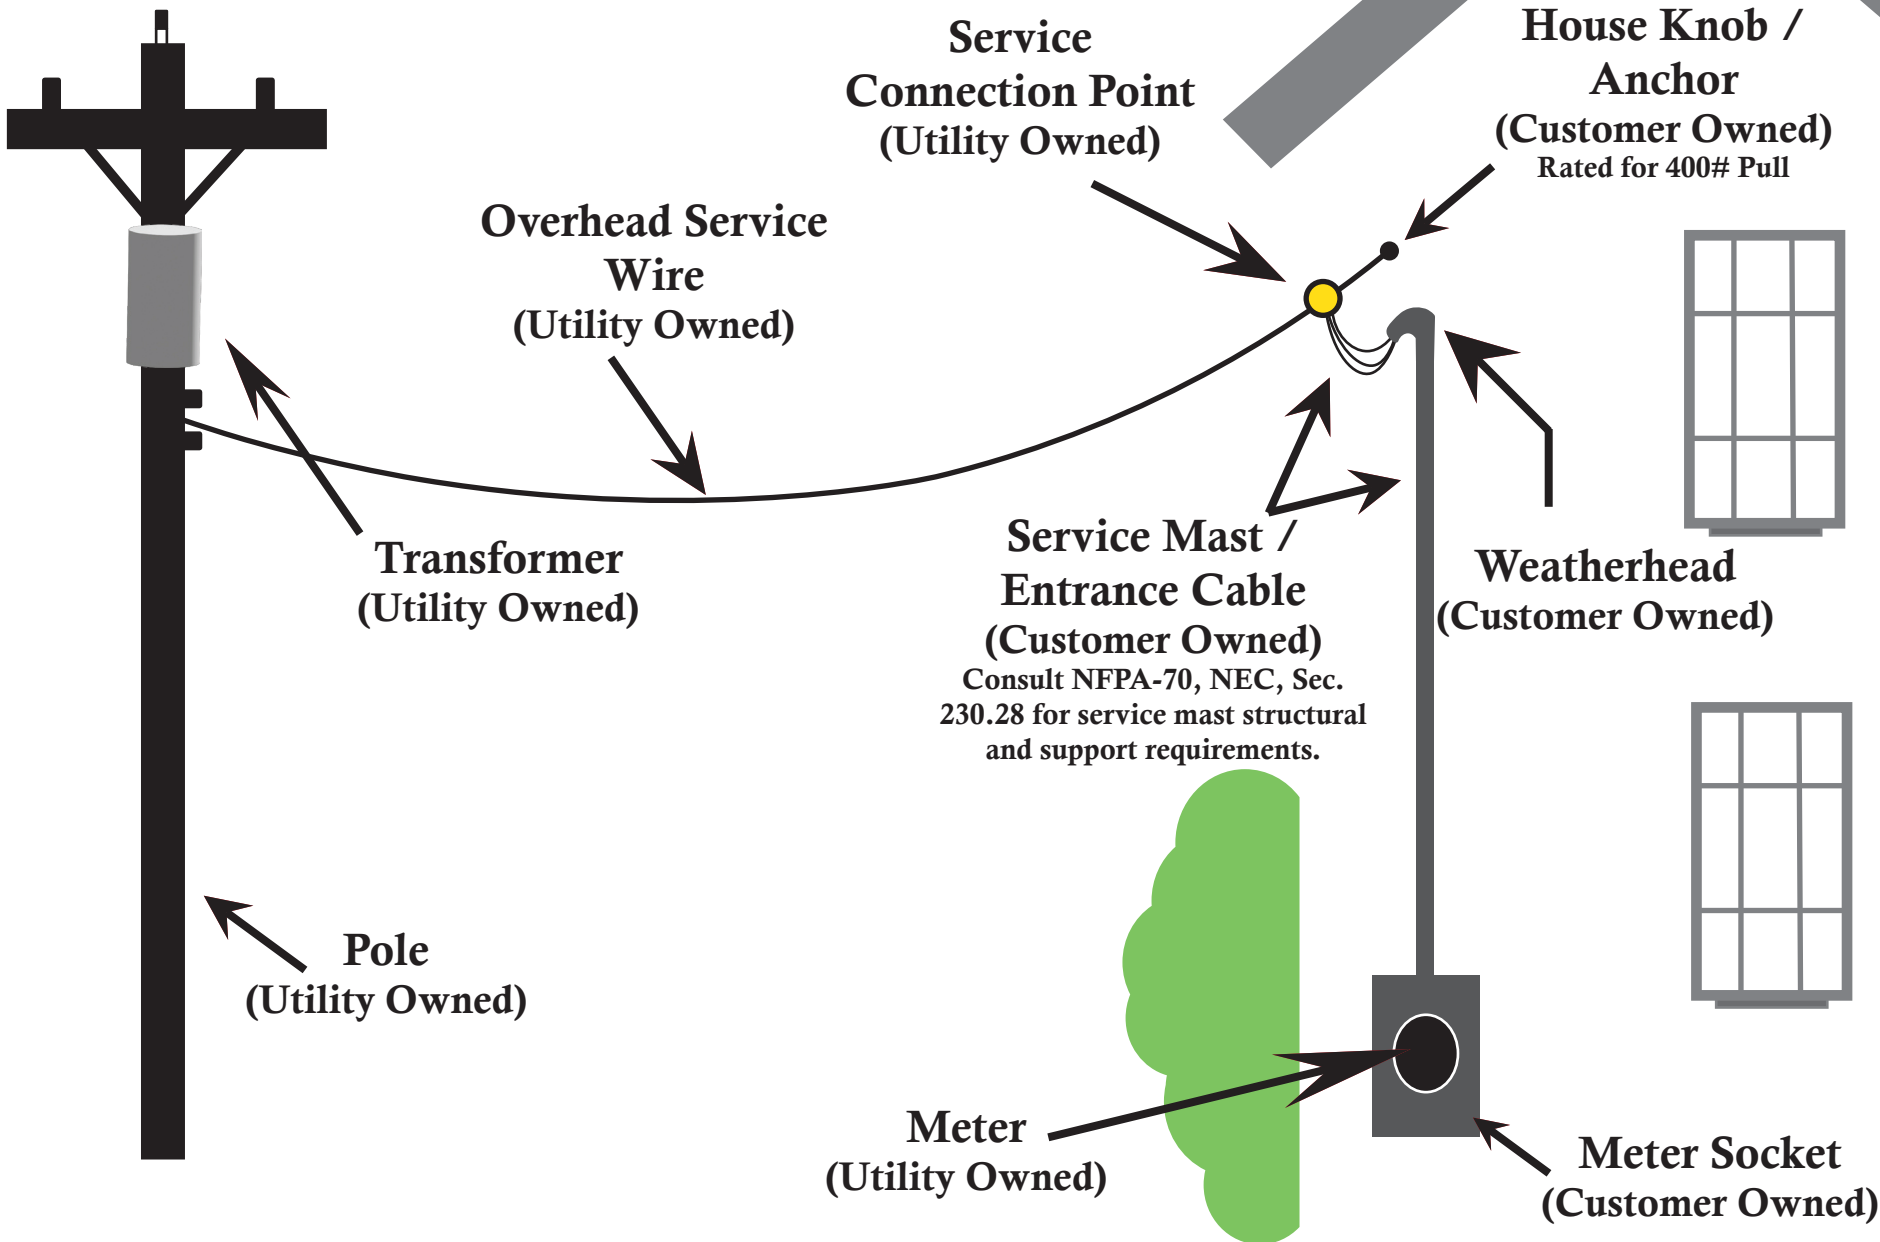

The National Electric Code (NEC) 110.26 requires a 30-inch wide space and 36 inches perpendicular to the meter socket be maintained as unobstructed working space. (i.e., this space should be kept clear of shrubs and fences).