

Specifications

Service Rules Schedule X-1:

- All water laterals must be of an undiminished size from street main to point of meter placement.


Additional MPU Standards

- Meter inlet and outlet piping must be adequately supported and anchored permanently to the wall or floor.
- Meter must be installed horizontally (per manufacturer).
- Adequate working space must be maintained around the meter at all times.

Department of Safety and Professional Services Code

SPS 382.40(8) Requires a meter bypass for meters 1-1/2" or larger.

SPS 382.40(4)
Requires building control valves upstream of the meter within 36" of service pipe entry into the building and a control valve downstream of the meter within 36" of the meter outlet.

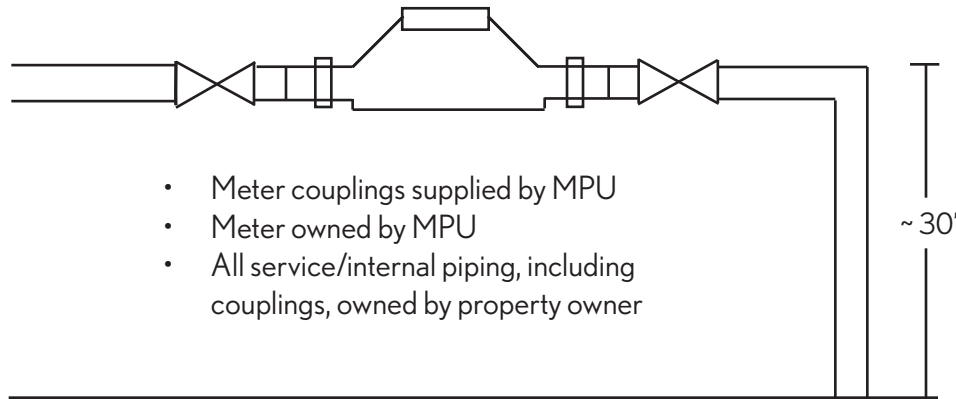

- Meter couplings supplied by MPU
- Meter owned by MPU
- All service/internal piping, including couplings, owned by property owner

MPU Water Distribution Service Manual

- Minimum 18" - Maximum 48" from finished floor
- Meter shall not be closer than 12" to any other installed device or appliance.